



FT12-105A (12V105Ah)

FT (Front Terminal) Series is specially designed for telecom use with 10+ years design life in float service. By adopting a new AGM separator and centralised venting system, the battery can be installed in any position while maintaining high reliability. The dimensions of the FT series is designed for 19" and 23" cabinet installation. It is suitable for UPS/EPS applications.



Specification

Cells Per Unit	6
Voltage Per Unit	12
Capacity	105Ah@10hr-rate to 1.80V per cell @25°C
Weight	Approx.32.5Kg (Tolerance±2%)
Max. Discharge Current	1050 A (5 sec)
Internal Resistance	Approx. 5 mΩ
Operating Temperature Range	Discharge: -20°C~60°C Charge: 0°C~50°C Storage: -20°C~60°C
Normal Operating Temperature Range	25°C±5°C
Float charging Voltage	13.6 to 13.8 VDC/unit Average at 25°C
Recommended Maximum Charging Current Limit	31.5 A
Equalization and Cycle Service	14.6 to 14.8 VDC/unit Average at 25°C
Self Discharge	RITAR Valve Regulated Lead Acid (VRLA) batteries can be stored for more than 6 months at 25°C. Self-discharge ratio less than 3% per month at 25°C. Please charge batteries before using.
Terminal	Terminal F8
Container Material	A.B.S. UL94-HB, UL94-V0 Optional.



G4M20206-0910-E-16






CERTIFICATE
Postcode:421001
is in conformity with
ISO 14001:2004 Standard




CERTIFICATE
Postcode:421001
is in conformity with
OHSAS 18001:1999 Standard

Dimensions

Unit: mm Dimension: 508(L)×111(W)×236(H)

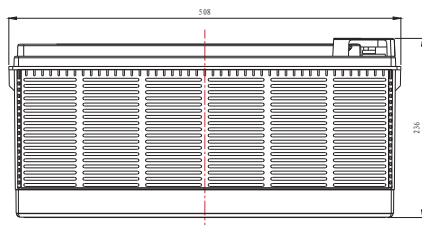

Terminal F8



Constant Current Discharge Characteristics: A (25°C)

F.V/Time	15MIN	30MIN	1HR	2HR	3HR	4HR	5HR	8HR	10HR	20HR
9.60V	181.1	105.5	65.54	40.46	27.50	22.17	18.41	12.12	10.93	5.78
10.0V	177.4	104.1	64.67	39.65	26.99	21.86	18.24	12.08	10.82	5.68
10.2V	173.6	102.6	64.05	39.23	26.75	21.64	18.12	11.97	10.71	5.57
10.5V	165.3	99.7	63.27	38.72	26.51	21.32	17.97	11.86	10.61	5.46
10.8V	152.4	96.4	62.39	38.40	26.20	20.59	17.88	11.81	10.51	5.40
11.1V	136.7	92.8	60.91	36.85	25.69	20.29	17.75	11.72	10.39	5.19

Constant Power Discharge Characteristics: W (25°C)

F.V/Time	15MIN	30MIN	1HR	2HR	3HR	4HR	5HR	8HR	10HR	20HR
9.60V	1967	1208	759.5	474.2	323.7	265.4	220.5	145.2	131.0	69.68
10.0V	1939	1195	752.6	468.4	318.9	261.7	218.5	144.6	130.0	68.47
10.2V	1917	1185	748.1	465.0	317.5	259.2	217.2	143.5	128.8	67.20
10.5V	1831	1161	743.3	459.2	314.9	255.7	215.5	142.3	127.6	65.93
10.8V	1709	1133	733.8	455.8	311.4	247.1	214.5	141.7	126.3	65.29
11.1V	1556	1102	722.8	438.7	306.2	243.5	213.7	140.7	124.9	62.96


All mentioned values are average values(Tolerance±2%).

FT12-105A


12V105Ah



Effect of temperature on long term float life

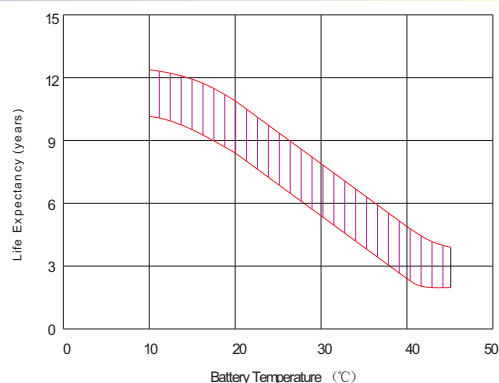

Storage characteristic

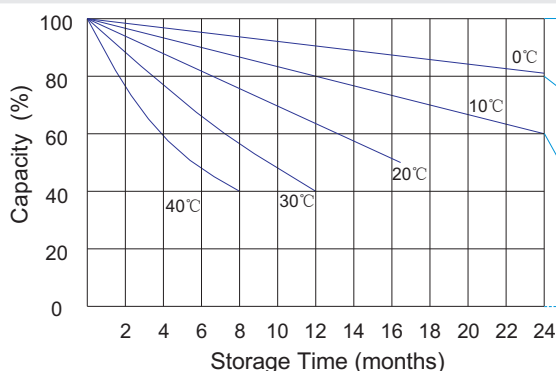


Supplementary charge required (Carry out supplementary charge before use if 100% capacity is required)

Supplementary charge required before use. This supplementary charge will help to recover the capacity and should be made as early as possible.


Supplementary charge may often fail to recover the capacity. The battery should never be left standing till this state is reached

Supplementary charge and storage guidelines

Charge characteristic Curve for standby use

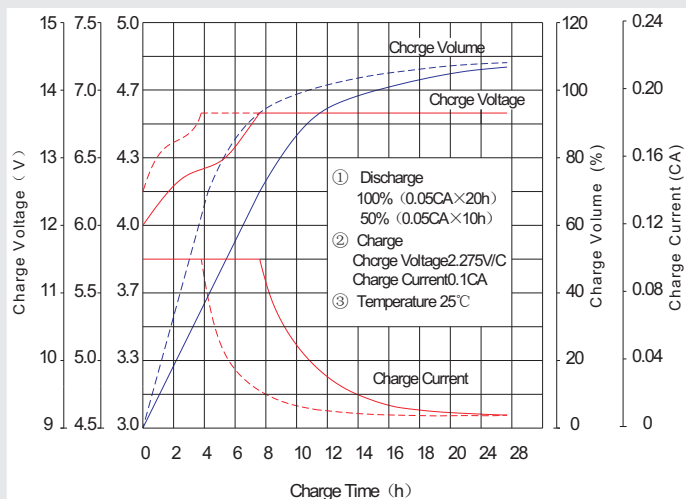

Discharge characteristic Curve

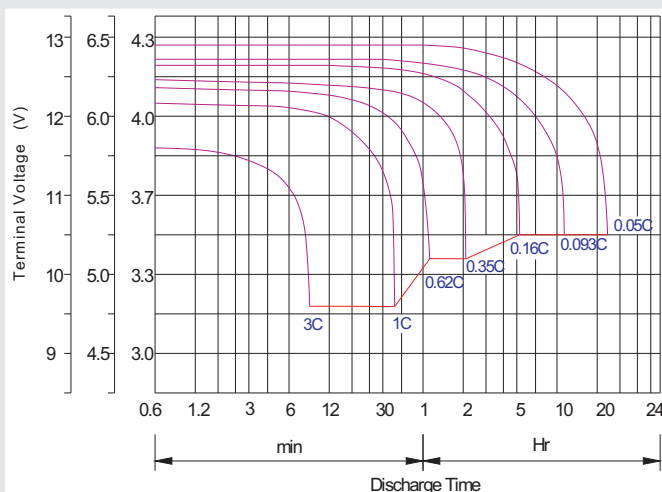

Capacity Factors With Different Temperature

Battery Type		-20°C	-10°C	0°C	5°C	10°C	20°C	25°C	30°C	40°C	45°C
GEL Battery	6V&12V	50%	70%	83%	85%	90%	98%	100%	102%	104%	105%
	2V	60%	75%	85%	88%	92%	99%	100%	103%	105%	106%
AGM Battery	6V&12V	46%	66%	76%	83%	90%	98%	100%	103%	107%	109%
	2V	55%	70%	80%	85%	92%	99%	100%	104%	108%	110%

Discharge Current VS. Discharge Voltage

Final Discharge Voltage V/cell	1.75V	1.70V	1.60V
Discharge Current (A)	(A) ≤ 0.2C	0.2C < (A) < 1.0C	(A) ≥ 1.0C

Charge the batteries at least once every six months, if they are stored at 25°C.

Charging Method:

Constant Voltage	-0.2Cx2h+2.4-2.45V/cellx24h, Max. Current 0.3C
Constant Current	-0.2Cx2h+0.1Cx12h
Fast	-0.2Cx2h+0.3Cx4h

Maintenance & Cautions

Float Service:

- ※ Every month, recommend inspection every battery voltage.
- ※ Every three months, recommend equalization charge for one time.

Equalization charge method:

Discharge: 100% rate capacity discharge.

Charge: Max. current 0.3CA, constant voltage 2.4-2.45V/Cell charge 24h.

※ Effect of temperature on float charge voltage: -3mV/°C/Cell.

※ Length of service life will be directly affected by the number of discharge cycles, depth of discharge, ambient temperature and charging voltage.

Bolt	M5	M6	M8
Terminal	F3 F4 F13 F18 T25 T26	F8 F11 F12-1 F15	F5 F9 F10 F12 F14 F16
Torque	6~7N·m	8~10N·m	10~12N·m

SHENZHEN RITAR POWER CO.,LTD.

Address: Rm405, Tower C, Huahan Building, Langshan Rd16, Nanshan District, ShenZhen, 518057, China

Tel:+86-755-33981668 Fax:86-755-8347-5180

URL: www.ritarpower.com

2012 - Version 1