



FTL12-185 (12V185Ah)

FT (Front Terminal) Series is specially designed for telecom use with 15 years design life in float service. By adopting a new AGM separator and centralised venting system, the battery can be installed in any position while maintaining high reliability. The dimensions of the FT series is designed for 19" and 23" cabinet installation. It is suitable for UPS/EPS applications.



Specification

Cells Per Unit	6
Voltage Per Unit	12
Capacity	185Ah@10hr-rate to 1.80V per cell @25°C
Weight	Approx.60Kg (Tolerance±1.5%)
Max. Discharge Current	1850 A (5 sec)
Internal Resistance	Approx. 4 mΩ
Operating Temperature Range	Discharge: -20°C~60°C Charge: 0°C~50°C Storage: -20°C~60°C
Normal Operating Temperature Range	25°C±5°C
Float charging Voltage	13.6 to 13.8 VDC/unit Average at 25°C
Recommended Maximum Charging Current	54 A
Equalization and Cycle Service	14.6 to 14.8 VDC/unit Average at 25°C
Self Discharge	RITAR Valve Regulated Lead Acid (VRLA) batteries can be stored for more than 6 months at 25°C. Self-discharge ratio less than 3% per month at 25°C. Please charge batteries before using.
Terminal	Terminal F9
Container Material	A.B.S. UL94-HB, UL94-V0 Optional.




Dimensions

Unit: mm

Dimension: 560(L)×125(W)×316(H)

Terminal F9

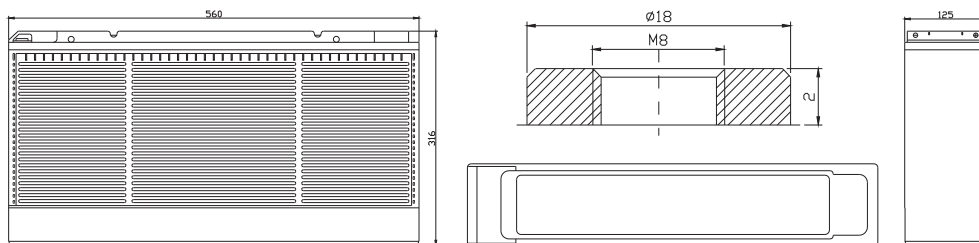

Constant Current Discharge Characteristics: A (25°C)

F.V/Time	5MIN	10MIN	15MIN	30MIN	1HR	2HR	3HR	4HR	5HR	6HR	8HR	10HR	20HR
9.60V	513.4	407.0	303.0	185.9	115.5	71.29	48.45	39.07	32.43	28.61	21.36	19.21	10.37
10.0V	498.5	387.2	296.9	183.5	113.9	69.86	47.55	38.51	32.14	28.36	21.27	19.03	10.18
10.2V	483.8	373.5	290.6	180.7	112.9	69.12	47.13	38.13	31.93	28.17	21.08	18.84	9.98
10.5V	434.4	344.7	276.7	175.7	111.5	68.21	46.71	37.56	31.66	27.94	20.90	18.65	9.79
10.8V	392.1	314.3	255.0	169.9	109.9	67.65	46.17	36.28	31.51	27.80	20.81	18.48	9.69
11.1V	336.4	280.9	228.7	163.4	107.3	64.93	45.26	35.75	31.28	27.60	20.64	18.26	9.30

Constant Power Discharge Characteristics: W (25°C)

F.V/Time	5MIN	10MIN	15MIN	30MIN	1HR	2HR	3HR	4HR	5HR	6HR	8HR	10HR	20HR
9.6V	5416	4334	3292	2128	1338	835	570	468	389	342.8	255.79	230.41	124.92
10.0V	5309	4201	3245	2106	1326	825	562	461	385	339.7	254.80	228.59	122.75
10.2V	5213	4090	3209	2087	1318	819	559	457	383	337.7	252.88	226.56	120.47
10.5V	4746	3809	3065	2045	1310	809	555	451	380	334.9	250.74	224.34	118.20
10.8V	4336	3493	2860	1996	1293	803	549	435	378	333.4	249.65	222.11	117.06
11.1V	3762	3169	2605	1942	1273	773	539	429	376	332.2	247.89	219.70	112.87


All mentioned values are average values (Tolerance ±2%).

FTL12-185


12V185Ah



Effect of temperature on long term float life

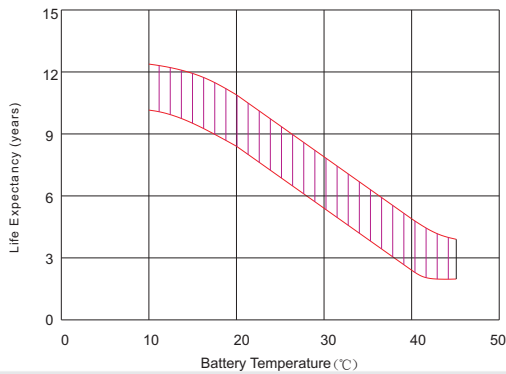

Storage characteristic

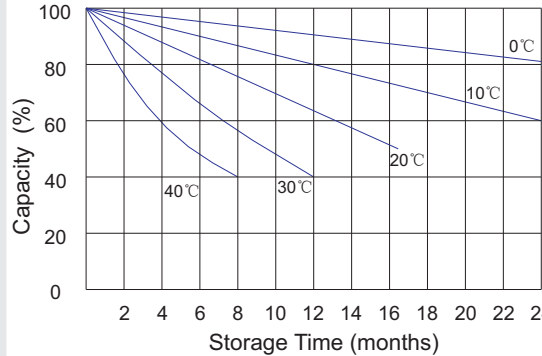


Supplementary charge required (Carry out supplementary charge before use if 100% capacity is required)

Supplementary charge required before use. This supplementary charge will help to recover the capacity and should be made as early as possible.


Supplementary charge may often fail to recover the capacity. The battery should never be left standing till this state is reached

Supplementary charge and storage guidelines

Charge characteristic Curve for standby use

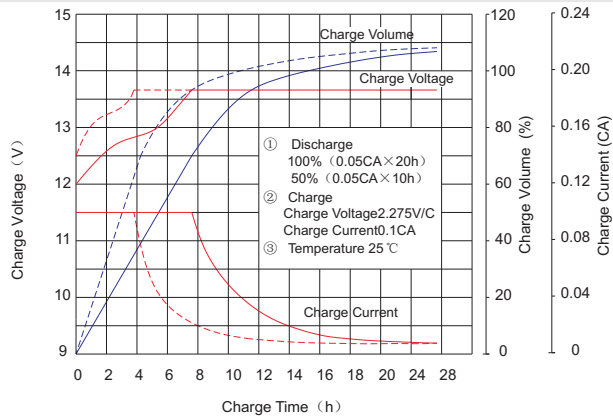

Discharge characteristic Curve

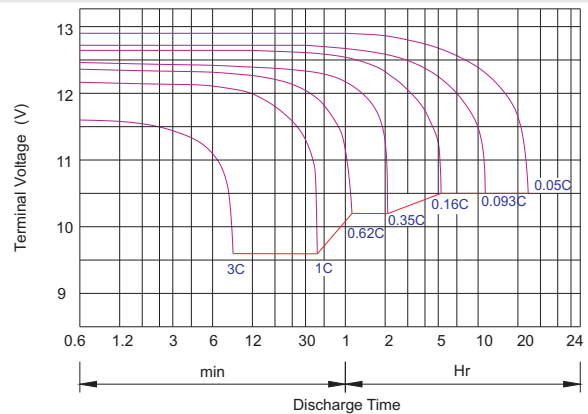

Capacity Factors With Different Temperature

Battery Type		-20°C	-10°C	0°C	5°C	10°C	20°C	25°C	30°C	40°C	45°C
GEL Battery	6V&12V	50%	70%	83%	85%	90%	98%	100%	102%	104%	105%
	2V	60%	75%	85%	88%	92%	99%	100%	103%	105%	106%
AGM Battery	6V&12V	46%	66%	76%	83%	90%	98%	100%	103%	107%	109%
	2V	55%	70%	80%	85%	92%	99%	100%	104%	108%	110%

Discharge Current VS. Discharge Voltage

Final Discharge Voltage V/cell	1.75V	1.70V	1.60V
Discharge Current (A)	(A) ≤ 0.2C	0.2C < (A) < 1.0C	(A) ≥ 1.0C

Charge the batteries at least once every six months, if they are stored at 25°C.

Charging Method:

Constant Voltage	-0.2Cx2h+14.4-14.7Vx24h, Max. Current 0.3C
Constant Current	-0.2Cx2h+0.1Cx12h
Fast	-0.2Cx2h+0.3Cx4h

Bolt	M5	M6	M8
Terminal	F3 F4 F13 F18 T25 T26	F8 F11 F12-1 F15	F5 F9 F10 F12 F14 F16
Torque	6~7N·m	8~10N·m	10~12N·m

Maintenance & Cautions

Float Service:

※ Every month, recommend inspection every battery voltage.

※ Every three months, recommend equalization charge for one time.

Equalization charge method:

Discharge: 100% rate capacity discharge.

Charge: Max. current 0.3CA, constant voltage 14.4-14.7V charge 24h.

※ Effect of temperature on float charge voltage: -3mV/°C/Cell.

※ Length of service life will be directly affected by the number of discharge cycles, depth of discharge, ambient temperature and charging voltage.

SHENZHEN RITAR POWER CO.,LTD.

URL:www.ritarpower.com

Address: Rm405, Tower C, Huahan Building, Langshan Rd16, Nanshan District, ShenZhen, 518057, China

Tel:+86-755-33981668 Fax:86-755-8347-5180

2015 - Version 0